


EXTENT OF DEMISE

PROPOSED AREA FOR
LICENSABLE ACTIVITIES

FIRE DETAILS:	LIFE SYSTEMS LEGEND:
FIRE BLANKET IN CONTAINER	HEAT DETECTOR
CARBON DIOXIDE FIRE EXTINGUISHER	SMOKE DETECTOR
9 LITRE WATER EXTINGUISHER	EMERGENCY LIGHTING
DRY POWDER EXTINGUISHER	ILLUMINATED EXIT SIGN
FOAM FIRE EXTINGUISHER	FIRE ALARM SOUNDER
F30 HALF HOUR FIRE RESISTANT WITH SMOKE SEALS & INTUMESCENT STRIPS	FIRE ALARM SOUNDER w BEACON
F60 ONE HOUR FIRE RESISTANT WITH SMOKE SEALS & INTUMESCENT STRIPS	FIRE ALARM PANEL
VP VISION PANEL	CALL POINT/BREAK GLASS
PB PANIC BOLT	FIRE ALARM INTERFACE
SC SELF CLOSING	
ALL EXTINGUISHERS ARE TO COMPLY WITH THE CURRENT BS EN STANDARDS. FIRE ALARM INSTALLATION - CONFORM TO L1 REGS EMERGENCY LIGHTING INSTALL - COMPLY BS 5266 PART 1	NOTE: THE CURRENT LOCATION OF FIRE SAFETY EQUIPMENT AND OTHER SAFETY EQUIPMENT IS SHOWN FOR INFORMATION ONLY. THE FUTURE AS NECESSARY AND APPLICABLE IN LUNSON WITH THE FIRE OFFICER. SEATING LAYOUT INDICATIVE ONLY

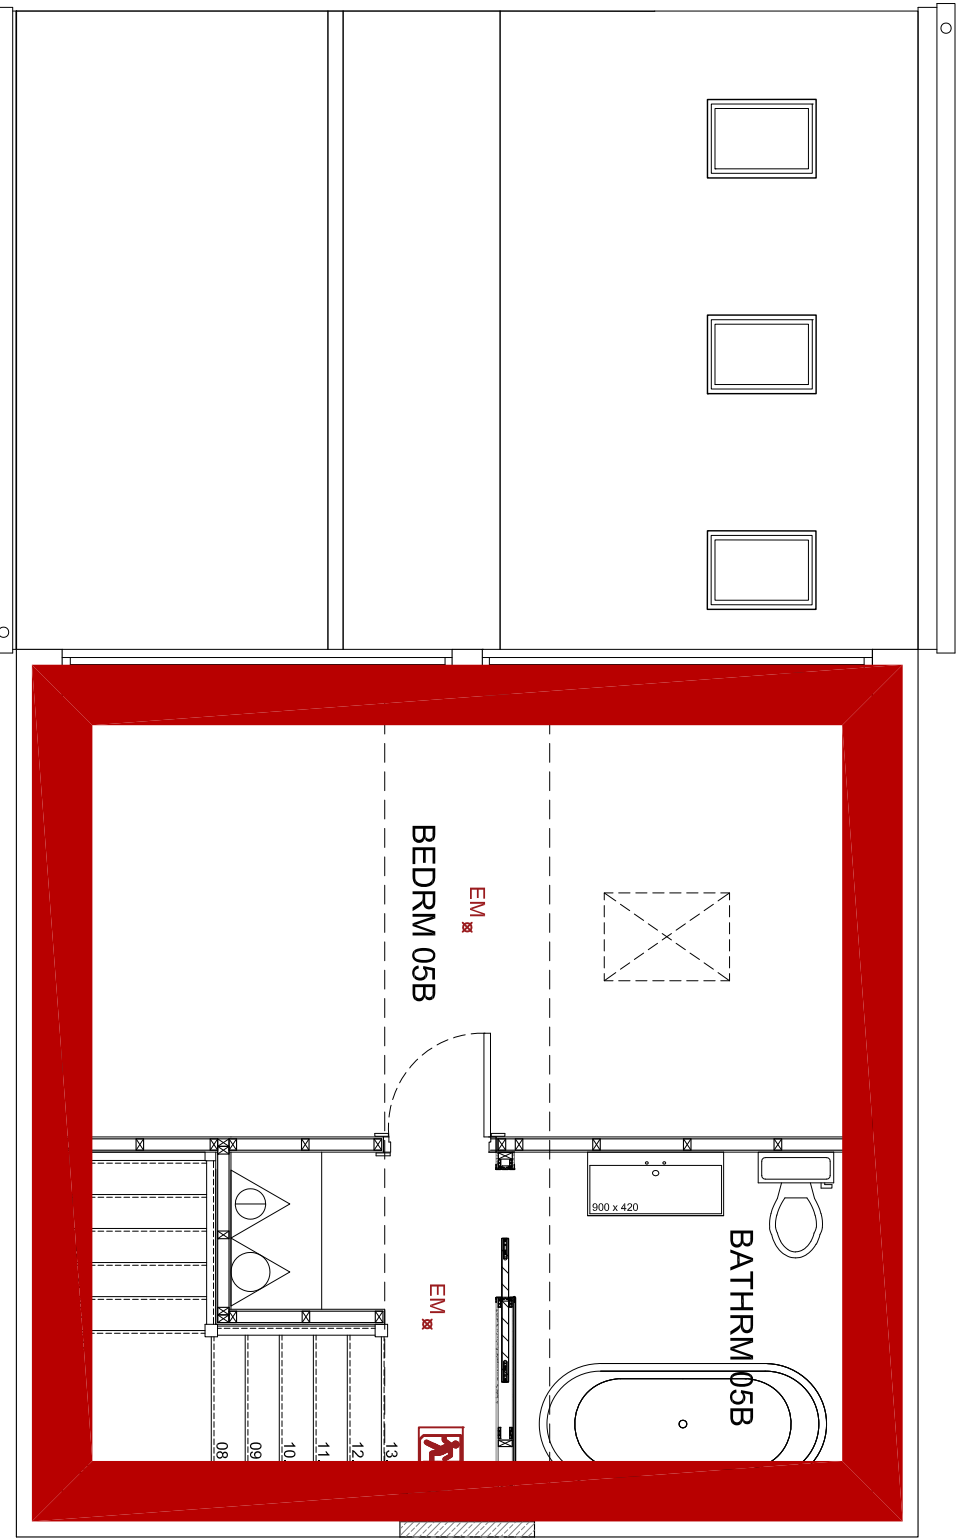

PROPOSED MAIN HOUSE
FIRST FLOOR PLAN

